TEF 730 Ex e
IECEx DRAINPLUG
USER MANUAL

IMPORTANT

Read this instruction carefully before installing the product

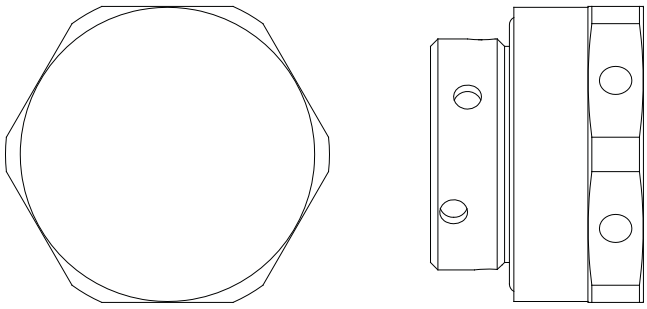

TEF 730

TUM 1049 REV. B 28.06.2011

Tranberg AS | P.O. Box 8033 | N-4068 Stavanger | Norway | Tel.: (47)51 57 89 00 | Fax.: (47)51 57 89 50
E-mail: info@tranberg.com | www.tranberg.com
Tranberg Systems | Hjulmagervej 15C | 7100 Vejle | Denmark | Tel.: (45) 75 85 83 80
E-mail: mail@tranbergsystems.com | www.tranbergsystems.com

TEF 730 Ex e DRAINPLUG USER MANUAL

INTRODUCTION

Thank you for purchasing this product!
For installation, maintenance and assurance of a long life of this product, please follow this manual.

APPLICATIONS

- Outdoor or indoor use in marine, offshore and industry environment

CONTENT IN BOX

The product is fully assembled, and ready for installation.

SAFETY PRECAUTIONS

Note that changes made to the product and/or installation of components which do not conform to the approval, may be a safety violation. The manufacturer will in no circumstance be held responsible for such activity.
For your health and safety, always use safety gear suited for the task. Be certain to follow codes, regulations and/or specific procedures that are related to the installation.

TOOLS REQUIRED

Wrench according to size of cable gland.

MAINTENANCE INSTRUCTIONS

The product should be inspected according to Company routines.

APPROVALS

NEMKO 02ATEX167, Issue 1

216432

IEC Ex NEM 11.0006

Atex / IEC Ex certified to comply with:

EN 60079-0: 2009 / IEC 60079-0: 2007

EN 60079-7: 2007 / IEC 60079-7: 2006

CSA certified to comply with:

IEC 60079 - 0:2000 and CAN/CSA E79-0-95

IEC 60079 -:2001 and CAN/CSA E79-7-95

INSTALLATION INSTRUCTIONS

For assembly for hole without threads:

1. Put drain in hole
2. Screw on lock nut and tighten firmly

Note:
Drain have to be assembled in bottom side of enclosure

Only lock nut special made for drain must be used

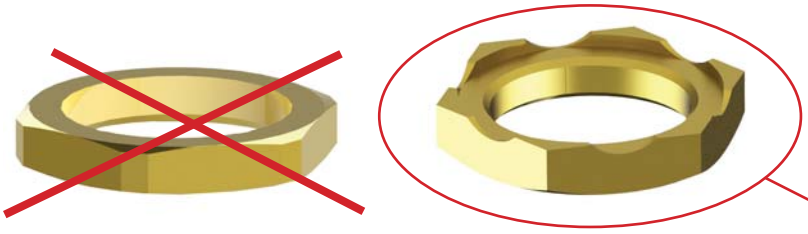

Assembly in hole without threads:

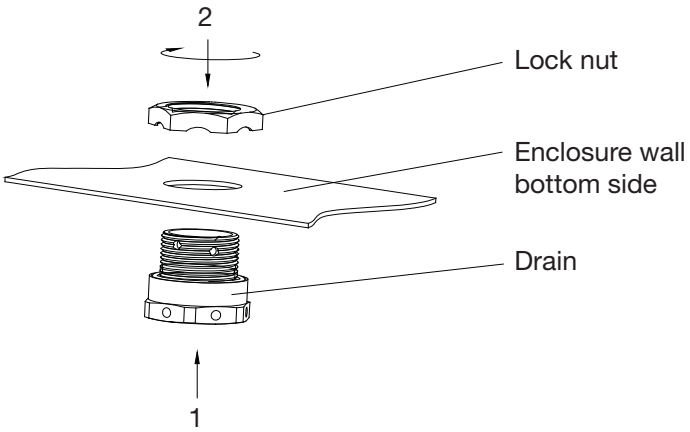



For assemlby in hole with threads:

1. Screw drain in hole and tighten it firmly

Note:
Drain have to be assembled in bottom side of enclosure

Drain must have a min. of 5 threads engaged, otherwise must lock nut be used.

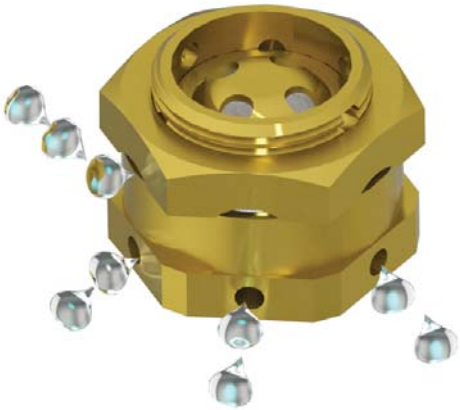

Assembly in hole with threads:

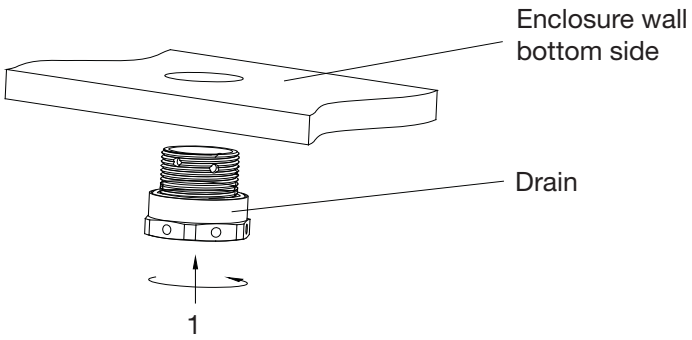



TEF 730 Ex e DRAINPLUG USER MANUAL

TECHNICAL DATA

Ex-protection ATEX:	Ⓔx II 2 G Exe IIC Gb
Ex-protection CSA:	Ex e II
IP-Protection:	IP66 according to EN 60529
Entry threads:	M25
Thread length:	9 / 15mm
Material:	Brass Also available in AISI 316/EN 1.4401
Application:	Outdoor enclosures
Function:	Drain inside water due to condensed air. Ventilate enclosure

Tranberg AS | P.O. Box 8033 | N-4068 Stavanger | Norway | Tel.: (47)51 57 89 00 | Fax.: (47)51 57 89 50
E-mail: info@tranberg.com | www.tranberg.com
Tranberg Systems | Hjulmagervej 15C | 7100 Vejle | Denmark | Tel.: (45) 75 85 83 80
E-mail: mail@tranbergsystems.com | www.tranbergsystems.com